

# AktoMech

## SCHNEIDER ELECTRIC ACB REPLACEMENT REQUIRED SPECIFICATIONS



Member of W.I.M.A.



72, Chrisostomou Smirnis Str. Piraeus Greece  
Tel: (00 30 210) 4131258, (00 30 210) 4221692  
[info@aktomech.gr](mailto:info@aktomech.gr) | [www.aktomech.gr](http://www.aktomech.gr)

# SCHNEIDER ELECTRIC ACB

## Replacement Requirements

To arrange the replacement of the SCHNEIDER ELECTRIC Air Circuit Breaker, please kindly send an email including the following details:

- **Email Subject:** SCHNEIDER ELECTRIC ACB REPLACEMENT
- **Company Name**
- **Vessel Name**
- **Sender Name & Department**
- **Sender Email Address**
- **Brief Description of the Issue**
- **Breaker Photographs:** high-resolution images clearly showing all relevant technical details must be provided (see examples). These photographs are required for proper assessment.
- **Electrical Diagram of the Breaker** – ensure it is clear and legible (see example).

**Note:** Clear and legible diagrams and photos are essential to properly assess the technical specifications.

1

### Type of breaker

Please provide a close-up photograph of the Air Circuit Breaker (ACB) nameplate clearly showing the breaker type.



②

## Overcurrent unit (Micrologic)


Please provide a close-up photograph clearly showing the overcurrent unit



③

## Specifications

Please provide a close-up photograph of the specifications nameplate

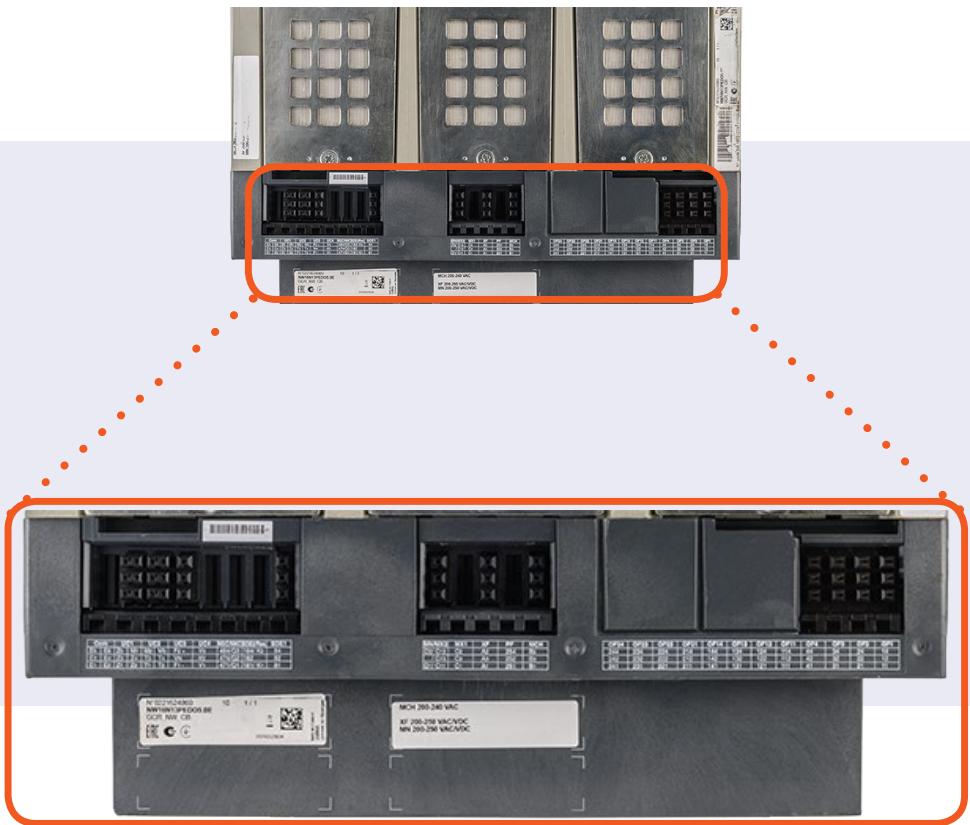

4

## Bus bar connection Horizontal or Vertical

Please provide the following photographs:

- A high-resolution photograph of the rear side of the cradle, clearly showing the cradle busbars.
- A high-resolution photograph of the rear side of the Air Circuit Breaker (ACB), clearly showing the ACB busbars.



Rear side of the cradle



Rear side of the breaker

5

## Main switch board (M.S.B.) electrical drawings

The control circuit diagram of the main switchboard must be provided to allow for cross-checking of the associated components and accessories.

